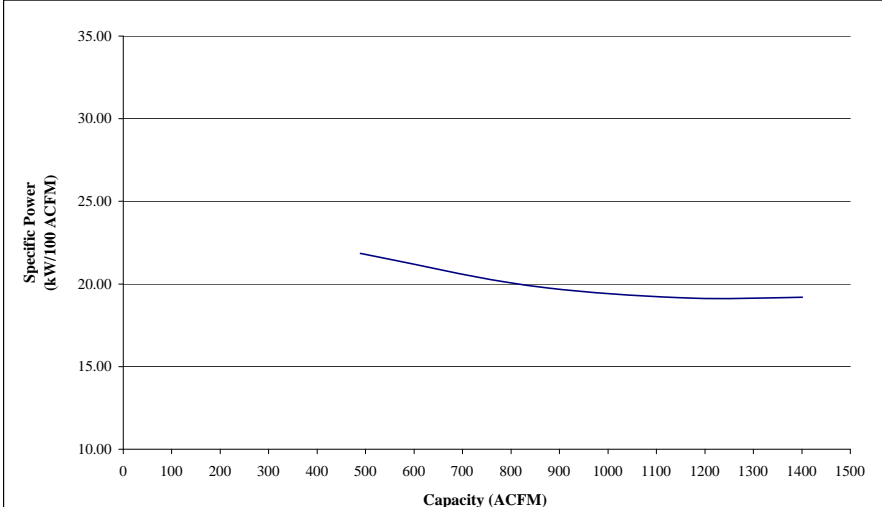


# COMPRESSOR DATA SHEET

## Rotary Compressor: Variable Frequency Drive

### MODEL DATA - FOR COMPRESSED AIR

1	Manufacturer: <b>Atlas Copco</b>		
2	Model Number: <b>ZR 250 VSD-125</b>		Date: <b>02-07-2012</b>
	<input type="checkbox"/> Air-cooled <input checked="" type="checkbox"/> Water-cooled		Type: <b>Screw</b>
	<input type="checkbox"/> Oil-injected <input checked="" type="checkbox"/> Oil-free		# of Stages: <b>2</b>
3	Rated Operating Pressure	<b>125</b>	psig <sup>b</sup>
4	Drive Motor Nominal Rating	<b>335</b>	hp
5	Drive Motor Nominal Efficiency	<b>95.3</b>	percent
6	Fan Motor Nominal Rating (if applicable)	-	hp
7	Fan Motor Nominal Efficiency	-	percent
8*	Input Power (kW)	Capacity (acfm) <sup>a,d</sup>	Specific Power (kW/100 acfm) <sup>d</sup>
	<b>269.1</b> Max	<b>1401.0</b>	<b>19.21</b>
	<b>222.0</b>	<b>1159.0</b>	<b>19.15</b>
	<b>165.9</b>	<b>833.0</b>	<b>19.92</b>
	<b>106.9</b>	<b>489.0</b>	<b>21.86</b>
	Min		
9*	Total Package Input Power at Zero Flow <sup>c, d</sup>	<b>22.9</b>	kW
10	 <p style="text-align: center;"> <b>Note: Graph is only a visual representation of the data in Section 8</b>                      Note: Y-Axis Scale, 10 to 35, + 5kW/100acfm increments if necessary above 35                      X-Axis Scale, 0 to 25% over maximum capacity                 </p>		

\*For models that are tested in the CAGI Performance Verification Program, these items are verified by program administrator

Consult CAGI website for a list of participants in the third party verification program:

[www.cagi.org](http://www.cagi.org)

NOTES:

- a. Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; acfm is actual cubic feet per minute at inlet conditions.
- b. The operating pressure at which the Capacity and Electrical Consumption were measured for this data sheet.
- c. No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- d. Tolerance is specified in ISO 1217, Annex E, as shown in table below:

NOTE: The terms "power" and "energy" are synonymous for purposes of this document

Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
$\frac{m^3}{min}$	$\frac{ft^3}{min}$	%	%	
Below 0.5	Below 15	+/- 7	+/- 8	+/- 10%
0.5 to 1.5	15 to 50	+/- 6	+/- 7	
1.5 to 15	50 to 500	+/- 5	+/- 6	
Above 15	Above 500	+/- 4	+/- 5	

ROT 031

10/11 R7

This form was developed by the Compressed Air and Gas Institute for the use of its members. CAGI has not independently verified the reported data.



